



NTPC Kudgi



NTPC Kayamkulam



NTPC Koldam



NTPC Experiences in Flexible Operation

I q b a l H a k i m (N T P C)








NTPC Rojmal



NTPC Bhadla



NTPC R&R Colony, Darlipali

Follow us on:  /ntpc1  /ntpcltd1  /ntpclimited  /Company/ntpc  /ntpclimited

All India vs NTPC Performance

All India Demand Scenario and Flexibilization

Present Flexibilization vis a vis NTPC Experience

Preparation for future Variable Load Operation

Challenges Ahead & Solutions

NTPC Expectations

Conclusion




NTPC-Powering India's Growth



Description	NTPC	All India	% Share
Installed Capacity-Coal	59.6 GW	206.2 GW	29.2 %
Generation (BU)-Coal*	376.3	1146	32.8%
Installed Capacity-Total	73 GW	424.3 GW	17.2%
Generation (BU)-Total*	399.3	1624	24.6%

* Gen figs are for FY 2022-23

- ❖ **Total Gen:** NTPC Contributes 1/4th in country's generation with only 1/6th share in installed Capacity
- ❖ **Coal Gen:** NTPC Contributes 1/3rd in country's generation.
- ❖ **Performance:** PLF of NTPC stations ~75% whereas national average is 64%

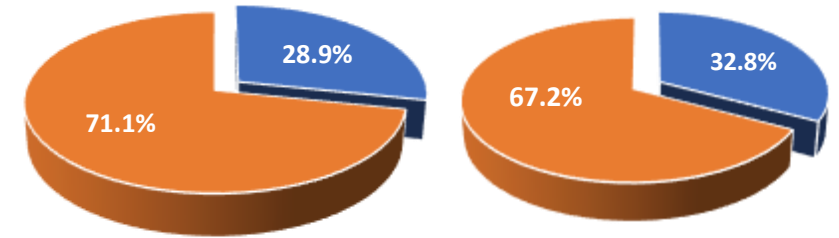

Installed Capacity-Coal

Generation (MU)-Coal

Fuel Type	Stations	Units	Capacity
	Nos	Nos	MW
Fully Owned			
Coal	27	121	52610
Gas	7	32	4017
Hydro	2	6	808
Solar	15	15	403
Total	51	174	57838
Joint Ventures/Subsidiaries			
Coal	9	25	7664
Gas	4	26	2494
Hydro	9	31	2949
Wind	3	3	163
Solar	15	15	2716
JV/Subs	40	100	15986
Total	91	274	73824







Demand Scenario and Flexibilization Requirements

Demand Scenario: Peak Demand Day-1 Sep 2023



Installed Capacity-423 GW

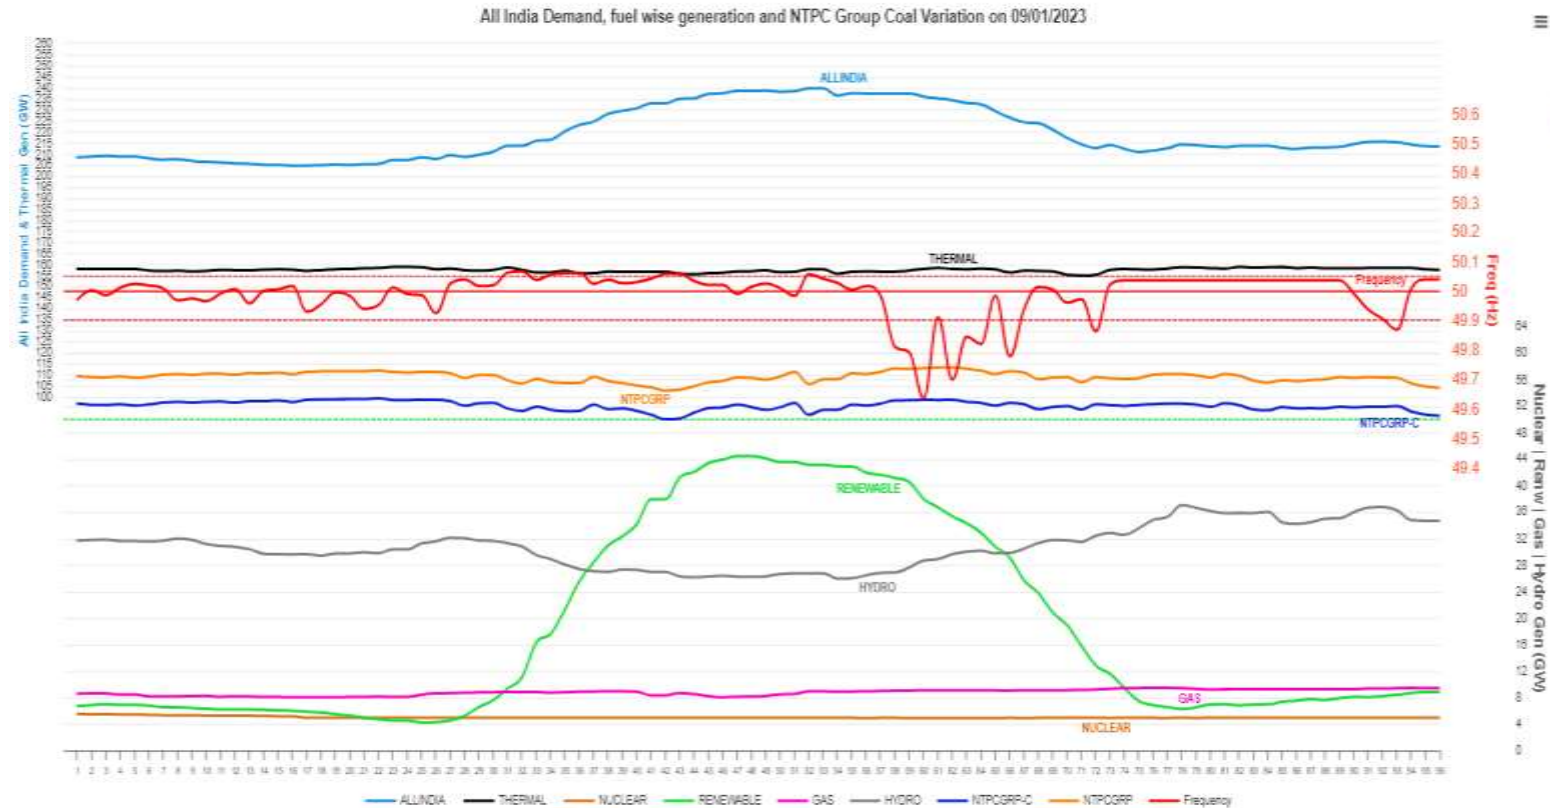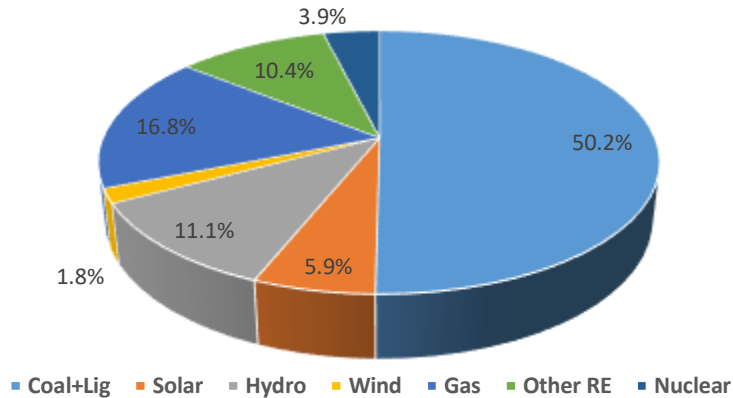

1 Sep'23	Max	Min	Difference	
	MW		%	
Demand	239663	204587	35076	17%
Thermal Gen	158988	152856	6132	4%
RE Gen	44463	4264	40199	943%
Hydro Gen	37048	25986	11062	43%
NTPC Coal	53167	50016	3151	6%


1. Present demand curve variations is moderate. Higher peaks & troughs expected by 2027 & 2032.
2. 40 GW of RE variation is absorbed largely by Hydro, Thermal & demand variation.
3. **NTPC Coal contributes 51% of the Thermal Flexibility despite having only 28% share in coal capacity.**




Capacity Scenario: FY'24 to FY'32 (As per NEP-May 23)




Installed Capacity-423 GW

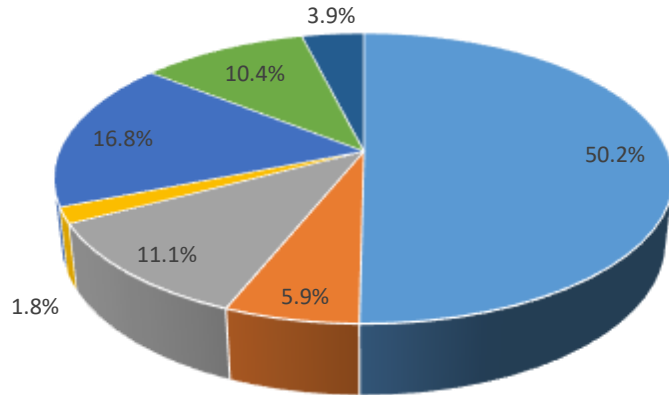

Ins Cap FY'27 -610 GW

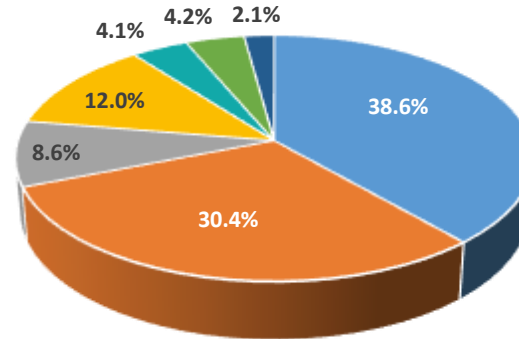

Ins Cap FY'32 -900 GW

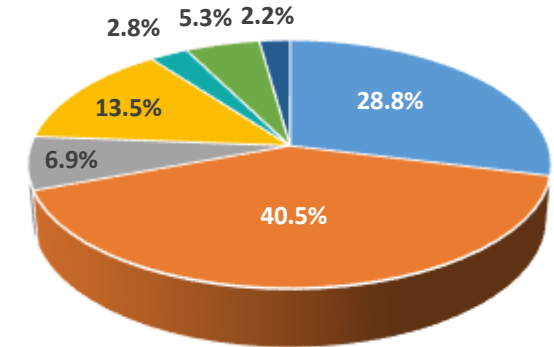

■ Coal+Lig ■ Solar ■ Hydro ■ Wind
■ Gas ■ Other RE ■ Nuclear

Annual cap growth	FY24-27	FY 27-32
	15%	10%

- ✓ Coal capacity increases marginally.
- ✓ The share of Coal decreases rapidly from 50% to 29%.
- ✓ Solar capacity share increase: 17% to 41%

Fuel	FY'24	FY'27	FY'32
Coal+Lig	212516	235133	259643
Gas	25038	24824	24824
Hydro	46850	52446	62178
Nuclear	7480	13080	19680
Solar	71145	185566	364566
Wind	43940	72896	121895
Other RE	16390	25646	47636
Total	423359	609591	900422



Demand Scenarios: FY'24 to FY'32 (Cap Figs as per NEP -2023)



01-Sep-23				Evening 8 PM		Afternoon 2PM		Night- 2 AM	
Fuel Type	MW	On Bar %	MW on Bar	LF	MW delivered	LF	MW delivered	LF	MW delivered
Coal+Lig	212516	86%	182764	85%	154435	86%	156263	88%	160832
Gas	25038	60%	15023	72%	10816	55%	8263	65%	9765
Hydro	46850	80%	37480	60%	22488	70%	26236	50%	18740
Nuclear	7480	80%	5984	75%	4488	75%	4488	75%	4488
Solar	71145	70%	49802	0%	0	70%	34861	0%	0
Wind	43940	70%	30758	58%	17840	30%	9227	45%	13841
Other RE	16390	40%	6556	30%	1967	20%	1311	20%	1311
Total	423359		328366		212034		240649		208977

1 Sep'23-Peak Demand Day (239 GW):

- ❖ **2 PM:** 65% of Peak demand met by Coal & 14% by Solar
- ❖ Solar variation 34 GW (14%) absorbed by Wind (5 GW), Hydro (8 GW) Gas (2 GW), coal (8 GW) & demand variation (11 GW).

Expected Scenario (2026-27)									
				Evening 8 PM		Afternoon 2PM		Night 2 AM	
Fuel Type	MW	On Bar %	MW on Bar	LF	MW delivered	LF	MW delivered	LF	MW delivered
Coal+Lig	235133	86%	202214	91%	183004	63%	127395	94%	190082
Gas	24824	40%	9930	72%	7149	42%	4170	65%	6454
Hydro	52446	80%	41957	60%	25174	36%	15104	50%	20978
Nuclear	13080	80%	10464	75%	7848	75%	7848	75%	7848
Solar	185566	70%	129896	0%	0	80%	103917	0%	0
Wind	72896	70%	51027	58%	29596	40%	20411	45%	22962
Other RE	25646	40%	10258	30%	3078	20%	2052	20%	2052
Total	609591		455747		255849		280897		250376

2026-27:

- ❖ **Peak Demand:** 277 GW
- ❖ **2 PM:** 45% from Solar & 37% from Coal
- ❖ Solar fluctuates from 0 to 37% (104 GW) which is to be accommodated by Wind (10 GW), Hydro (10 GW) Gas (3 GW), Coal (56 GW) & demand variation (25 GW)

Expected Scenario (2031-32)									
				Evening Peak (8 PM)		Afternoon 2PM		Night- 2 AM	
Fuel Type	MW	On Bar %	MW on Bar	LF	MW delivered	LF	MW delivered	LF	MW delivered
Coal+Lig	259643	86%	223293	100%	223293	44%	98249	100%	223293
Gas	24824	40%	9930	72%	7149	42%	4170	65%	6454
Hydro	62178	80%	49742	60%	29845	36%	17907	50%	24871
Nuclear	19680	80%	15744	75%	11808	75%	11808	75%	11808
Solar	364566	70%	255196	0%	0	80%	204157	0%	0
Wind	121895	70%	85327	58%	49489	40%	34131	45%	38397
Other RE	47636	40%	19054	30%	5716	20%	3811	20%	3811
Total	900422		658286		327301		374233		308634

2031-32:

- ❖ **Peak Demand:** 366 GW
- ❖ **2 PM:** 55% from Solar & 26% from Coal
- ❖ Solar fluctuates from 0 to 55% (204 GW) which is to be accommodated by Wind (15 GW), Hydro (12 GW) Gas (3 GW), Coal (125 GW) & demand variation (42 GW)
- ❖ Storage Solutions to supply 10 to 20 GW



Flexible Operation at NTPC- Business Requirements; Intervention Areas

Learning Within

Business Requirements

⑩ Technical

- ⑩ Faster Ramps
- ⑩ Stable Lower Load
- ⑩ Safe Operation
- ⑩ Environment Friendly

Commercial

- ❖ To Make Station Flex Ready
- ❖ Part Load Operation Compensation
- ❖ Incentivization for Part load Operation



Intervention Areas

Boiler

Turbine

Operations

Control Systems



On an average NTPC Units Flex 15 GW on daily basis. Non Pit Head Stations Flex from 55% to 100%. This has resulted in challenges in Boiler, Turbine, Control Systems which NTPC is addressing on continuous basis.



Boiler- Fatigue Failure Control



Challenges

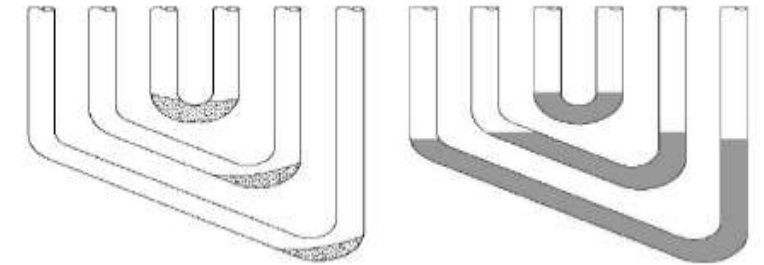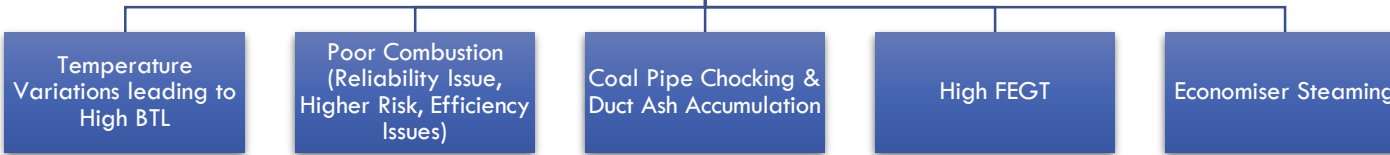

Full & Partial Chokage Due to Exfoliation

Full Chokage Due to Condensate

Source: EPRI


Mitigation Measures

During Unit Operation <i>(Damage Mechanism due to large variation in Steam temperatures)</i>	Ramping: Large variation in Steam Temp (25 to 40 C)
	Mitigation: Loop Tuning Groups
	Optimum Scheduling: Engagement with grid agency to optimize load variations.
	Condensate blockade in pendant loops during high spray to control tube metal temperature.

During Unit Shutdown	Identifying Incipient Defects by Cyclic Hydro.
	Dry air preservation to prevent tube pitting.

During Unit Overhaul	Attachment modifications as per EPRI guidelines.
	Both Side Fin Welding (earlier only one side).
	Checking of attachments by DPT.
	Checking of innermost bend for cracks.
	Adoption of RFET, AET, Exfoliation, Ther Flow, Thermo vision test

No of Unit Outages on Fatigue BTL

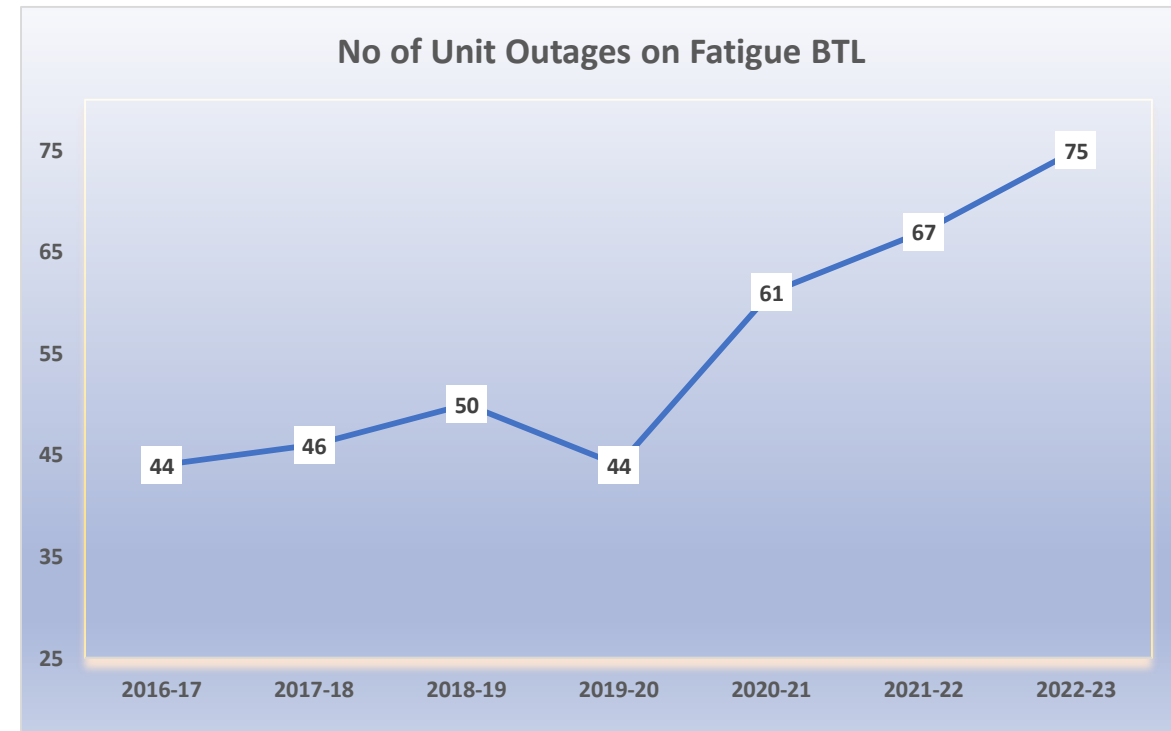


Turbine- Challenges and Mitigation Measures



Challenges

- High Vibration of Rotor Train.
- Increased Ovality & Decreasing hardness of Casings.
- Increased Potential of LP Blade Failure.
- Severe Deposition on Turbine Blades.
- Damage to Turbine Valves
- Excessive Exhaust Hood spray leading to LP blade erosion

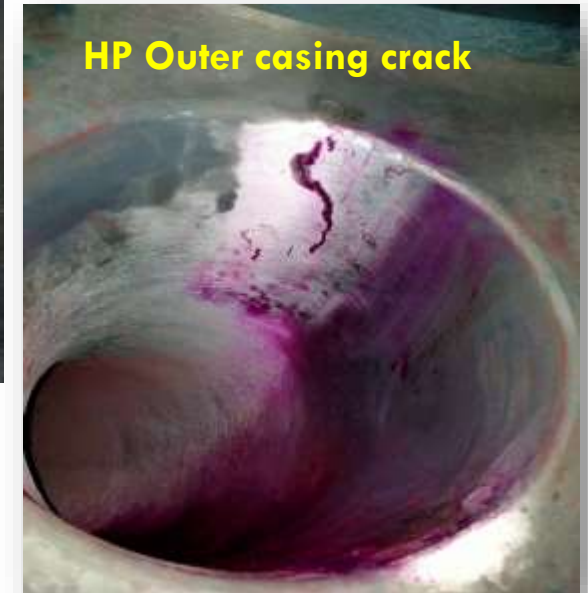

Challenges	Actions
HP casing crack	RLA of casing every 6 yrs (13 yrs). Replacement of casings & rotor in 15 yrs (25 Yrs)
Chance of LP blade crack	Frequent inspection- 2 yrs (4 Yrs) , MPI- In-situ PAUT- 2 yrs (4 yrs)
LP Turbine blade fluttering	Mistuning of free standing blades, Installation of BVMS system
High vibration of rotor trains	Turbine Bearings inspection in every 2 yrs (4 yrs).
Increasing ovality & reduction in hardness of Casing	More frequent replacement of casings, rotors.
Damages of steam valve internals	Frequent inspection & maintenance



High metal temperature of blading, seals, Turbine rotating and stationary structures as well as Cold Reheat Piping => excessive distortion and/or creep damage (Casing and Rotor)



Operations and Controls- Challenges and Mitigation



Area	Challenges	Mitigation Measures
Operations	<ul style="list-style-type: none"> High Ash deposition on ducts. Soot blowing difficulty, Need > 70% load for 3 hr in a day Flame disturbance tripping on Coal Quality variations Higher chances of outage due to single Aux Eqp approach. Chemistry parameter variation (PH, Conductivity, DO etc) 	<ul style="list-style-type: none"> Unlearn and Relearn Strategy New Operational Practices
Controls	<ul style="list-style-type: none"> AGC RGMO 	<ul style="list-style-type: none"> Loop Tuning Interventions through Policy advocacy for changes in procedures




Variations in coal quality



Combustion and Flame Stability



Ash Deposition at Low Loads

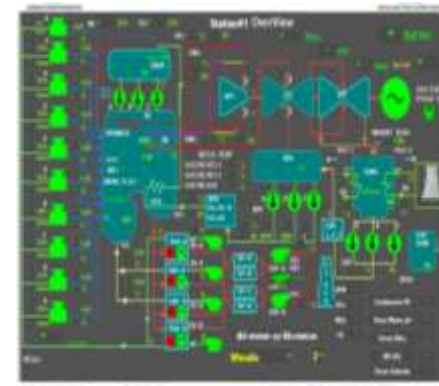

Tuning - Control loops






Flexible Operation at NTPC- Partnerships
and Tests with Expert Agencies/OEM's

Learning
Outside

Various Studies on Variable Load Operation

Study Associates	Station	Scope
J-Coal/TEPCO, Japan	Vindhyachal 11, Mauda 3,4– 500 MW	MTL @55% with 3% ramping. Efficiency at different part load condition
IGEF/VGBE, Germany	Dadri U 6 (500MW)	MTL (40%) & 3% Ramping
GE, USA	Talcher-K Unit 1 (500 MW)	MTL (40%)
USAID/BHEL	Mauda Unit 2 (500 MW)	MTL (40%)
EPRI, USA	Solapur, Gadarwara, Simhadri, Bongaigaon, Farakka and Unchahar	Identifying gaps in O&M practices
USAID/INTERTEK, USA	Ramagundam U#2 (200 MW) Jhajjar U# 1 (500 MW)	Cost of flexing due to start up and load following
Engie Lab (France/Belgium)	Dadri Unit 4 (200 MW) Farakka Unit 6 (500 MW)	Strategy for transition to flexible opn. and Estimation of Capital Cost

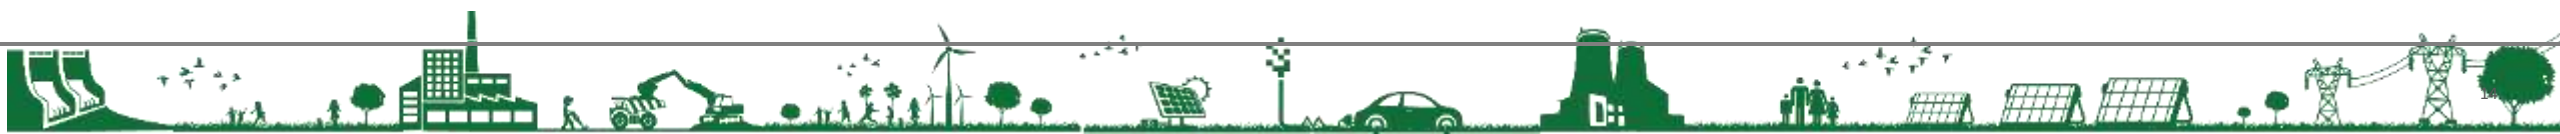

Common Observations of the Pilot Studies

- ❖ Parameter Fluctuation
 - Excessive fluctuations in Steam temperatures.
 - High Drum level swings during ramping.
- ❖ Flame disturbance during ramping.
- ❖ Occasional furnace pressurisation.
- ❖ Stalling of Primary Air fans at low loads.
- ❖ Low boiler flue gas exit temperature, leading to acid corrosion.



Ramp

- ⑩ Command @ 3%
- ⑩ Actual @ 1.3-1.4%


40% MTL

- ⑩ 1 Each of BFP, FD, ID, PA
- ⑩ Flame Failure if any aux trips

Tests


- ⑩ Controlled Environment
- ⑩ Quality Coal
- ⑩ Expert Presence

Ramp test at Tata Maithon & DVC Andal results was at par with Dadri

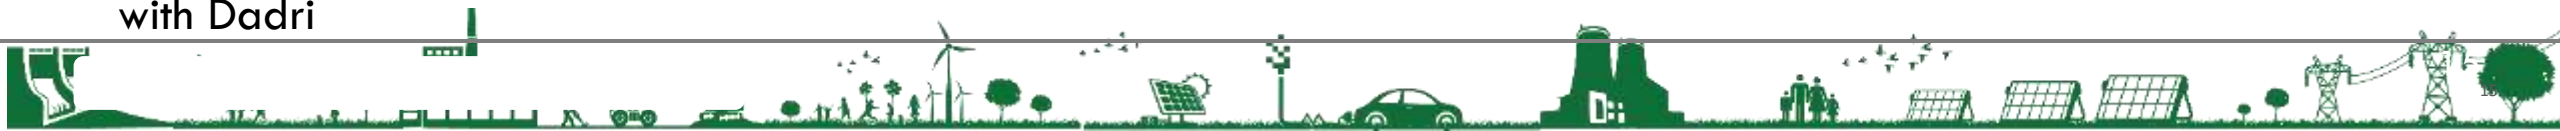



Flexible Operation at NTPC-
Implementation of Learnings

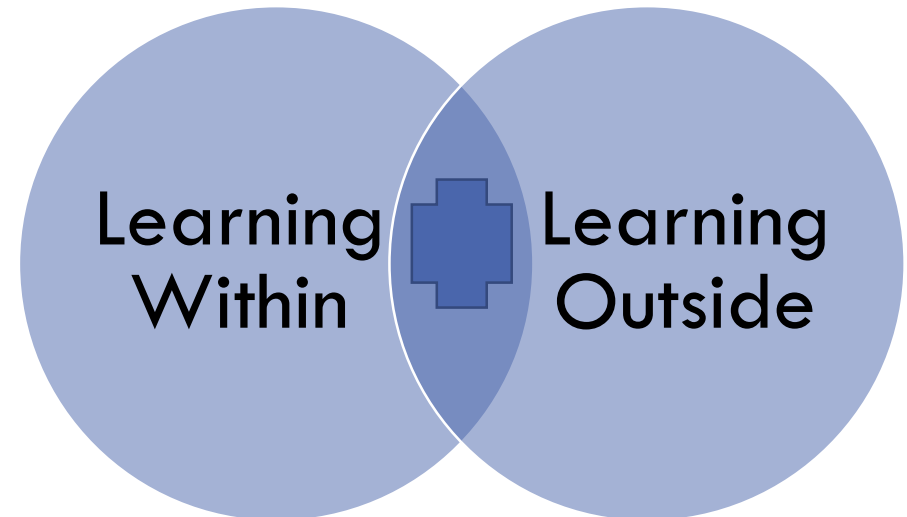

Processes Implemented

- ⑩ Intelligent Proactive Process control
 - ⑩ (MS HRH temp, Flue gas temp. etc.)
- ⑩ Single drive operation (Higher Efficiency & Lower Reliability)
- ⑩ Automated Milling System
- ⑩ Condition monitoring system
- ⑩ Combustion Optimisation
- ⑩ Boiler Fatigue Monitoring system (BFMS)
- ⑩ Unit Response Optimisation (Reduce Over & Undershoots)

Work with M/s Siemens & Emerson

Hardware E&C (Control panel, BFP R/c valves replaced)

ID, FD ,PA , Mill SGC

Sliding pressure implementation

TDBFP and MDBFP SGC

BFMS : Commissioning done

Condensate throttling, Unit control, Drum & S/H control





NTPC Strategy for Variable Load Operation

3-Pronged Strategic Approach for Variable Load Operation



Technology

- Control & Monitoring System for early warning & smooth operation
- Schematic & Technological/Metallurgical upgrades
- Partnership (National/Global)

Technical Up-gradation

- OEM/Expert Support
- Boiler Combustion System
- Boiler Fatigue Monitoring System
- Vibration Monitoring System
- Control Optimization etc



Process

- Capital OH reduced from 6 to 4 Yrs.
- Optimisation of Overhauling Interval
- Control Loop Tuning
- Studies- OEM/ Experts


Regulatory Support

- Incentives for making units Flex Ready
- Compensation Mechanisms for Low Load Operation
- Higher Incentives for Voluntary low load contribution.
- Uniform implementation for all grid connected entities irrespective of Ownership



People

- Training & Development.
- Centralized Tuning group
- Collaboration with International agencies like EPRI, JICA etc
- Simulator training





Industry Peers

- All Gencos including states at 55% MTL
- OEM support
- Collaboration



Regulators

- Compensation for life consumption (Capex, Opex, Additional Spares)
- Incentivization



Grid Operator

- Flexible Rules and Procedures
- Stable Grid, Less frequency variations
- Forecasting



Govt of India

- Policy Support
- Low Cost Funding
- Balanced capacity

Change is Inevitable; Growth is Optional



- **Criterion:** Based on COD. The criterion for selecting of the units should be more inclusive and should inter-alia include the factors like Size, Location, Age, ECR, Distance from mines, Environmental issues, OEM availability etc
- **Pilot: 11 Units. More data**
- **Treatment of Supercritical Units:** Dry to wet Changeover
- **Technical Challenges**
 - Flame Stability: Poor Coal, Rainy Season
 - Ash Settlement
 - Attachment Failures



**Capex:
(Systems/modifications required.)**

Additional Capital Spares

Drive Turbine ACV modification / BFP R/C valve modification

Condition Monitoring System (BFMS; TSE; Rotor Flux Monitor; Partial Discharge Monitor)

Control equipment/strategies upgradation

Turbine VMS (Blade VMS; Casing VMS)

Combustion Optimisation Module

Approximate Cost: **90 Cr**

- Irrespective of R&M

Fixed Cost: Penalty to be removed as generator is bearing the cost in DSM. Double penalty will adversely impact generator viability.

O&M Cost: Due to increased life consumption (damage cost). Introduce Flexibility Factor





NTPC Kudgi



NTPC Kayamkulam



NTPC Koldam



Thank You



NTPC Rojmal



NTPC Bhadla



NTPC R&R Colony, Darlipali

Follow us on:



/ntpc1



/ntpcltd1



/ntpclimited



/Company/ntpc



/ntpclimited



Cost of Flexing

Cost Factors for Flex Operation

- Flex ready
 - Modifications
 - Monitoring
 - Control tuning
 - Operator training
- O&M Expenses
 - Increased premature equip damage
 - Increased maintenance
 - Inspection frequency and scope
 - Preventive maintenance
 - Higher inventories of Spares
- Deterioration
 - Heatrate
 - Aux Power Consumption
 - Specific Oil Consumption

- Motivation of the Generator



Capital Expenditure & Operating Expenditure



S. No	Head	Capex (Rs in Crores)
1	Turbine	18.9
2	Boiler	21.5
3	Electrical	40
4	C&I	10
5	Others	2.1
	Total	92.5

Approximate increase in FC per unit is 5 paise to 8 paise at 85% and shall be reducing year on year (depends on how many years capitalization is allowed/remaining useful life)
1Cr/MW - 28 paise

S. No.	Head	Opex / Year (Rs in Crores)
1	Turbine	18.4
2	Boiler	8.5
3	Electrical	2.62
4	C&I	0.125
5	others	0.12
	Total	29.76

Increase in O&M cost per MW: 5.95 lacs/MW

Increase in energy cost per unit due to O&M cost at 85% PLF: 8 paise/kwh
Extra compensation due to Heat rate and APC for 40% loading to be added



Approximate Cost for Interventions for Flexibility

Area	Intervention Areas	Appr Cost
Turbine	Capital Expenditure to augment Main Turbine Spare (HP/IP/LP Turbine & Bearing)	19 Cr
	ACV modification / BFP R/C valve modification	
	Yearly expenditure (Services) Material & Spares per year	18 Cr
Boiler	Metallurgy improvements	25 Cr
	Replacement of tubes/Bends OH, Inspection, Repair etc	8.5 Cr
Electrical	Stator, Rotor, Spare Bar etc	40 Cr
	Services	3 Cr
C&I	Extending CMC up to 40% / ramp rate improvement / improved controls for Steam temp, Drum level, Feedwater pumps, etc / Start & stop sequence for drives / Mill Scheduler / etc	10 Cr



Turbine Capex for a 500 MW unit (CAPEX)

S.No	Description (One time Additional spare required for higher life consumption due to flexible operation)	Rs. In Cr. Per Unit
1	Additional Capital Expenditure to augment Main Turbine Spare (HP/IP/LP Turbine & Bearing)	12.1154
2	Drive Turbine ACV modification / BFP R/C valve modification	3.0000
3	Drive Turbine Rotor, fixed blade, Valve spare	1.5385
4	Integrated monitoring system for Equivalent operating hours based on life consumption due to cyclic loading	2.0000
5	Equivalent Operating Hours Counter for the Turbine	0.2500
	Total One time Capital Expenditure/Unit	18.90



Turbine Opex for a 500 MW Unit (OPEX)

S. No.	Additional yearly expenditure (Services) due to increased frequency of maintenance	Cost/Year (in Cr.)
1	LPT Overhaul and Bearing Inspection	0.405
2	HP/IP/LP Maintenance/Overhauling	0.1662
3	Major valve (TG/HPLP/Modulating CV etc) Maintenance/Overhauling	0.2890
4	Major Pump (BFP/CEP) Maintenance/Overhauling	0.2022
5	Drive Turbine Maintenance/Overhauling	0.1500
6	RLA of Turbine components	0.0312
	Total expenditure Service/year/unit	1.25
	Additional yearly expenditure Material & Spares per year	Per Unit
1	General spares, Consumables @ 3 times of service cost	3.731
2	Repair and refurbishment of HP/IP/LP turbine and bearing (four year cycle)	7.875
3	Repair/Replacement and refurbishment of TG valve spares	1.50
4	Replacement sapre for Critical Modulating Control valves (CEP RC/DA CV/FRS CV/Drip CV) Per year	2.80
5	Repair and refurbishment of Major pump subjected to cycling loading (BFP/CEP etc)	1.25
		17.15
	Total Yearly Expenditure/Unit in crores	18.40



Boiler Capex Per Unit (in Cr)



CAPEX	200 MW	500 MW	660 MW	800 MW
Metallurgy improvements in in SH/RH headers	7	10	0	0
Replacement of tubes/Bends (Overheating/Exfoliation)	3	5.5	1	1
Strengthening cost for Goose neck , back pass Slope and ducts for ash accumulation. Putting blowers and hoppers	0.5	1	2	2
Replacement of Economiser and Eco inlet bends for FAC (upgraded material) Drains & Vents	1.5	3	0	0
Use of Artificial Intelligence (AI) for Pr Parts Header & Tube Health Assessment & Replacement Plan	1	1.5	2	2
Combustion Optimisation (Online Coal Flow Measurement portable) and SH & RH Spray Valves	3	4	4	4
Total Capex (One Time for 15 Yr)	15	25	9	9



Boiler Opex Per Unit (in Cr)



OPEX	200 MW (Cr.)	500 MW (Cr.)	660 MW (Cr.)	800 MW (Cr.)
Increase of BTL Cost (2BTL/Yr)				
Increase of 2 BTL/yr due to fatigue	2	4	6	10
Increased overhaul cost				
Inspection: DPT, MPI of DMW IPW, Header stub joints.	0.5	1	1.25	1.5
Repair: Increased boiler tube HP joints	0.25	0.5	0.5	0.5
Material cost (approx)	0.5	0.75	1	1
Inspection of Power Cycle	0.25	0.5	0.55	0.75
Hanger and Supports Inspection and rectification	0.15	0.2	0.5	0.5
Inspection on Attachment, drain piping etc and insulation	1.15	1.2	1.5	1.5
Increased Breakdown/ Servicing of Fans	0.1	0.25	1.5	2
Duct/ expansion/ Gate Inspection & Maint	0.1	0.1	0.2	0.25
ADDITIONAL O&M COST PER YEAR	5	8.5	13	18



Electrical Capex for a 500 MW unit



Item Description	Population	Spare	Additional Requirement	Rate	Total Cost Implication(in Cr)
Generator Stator (BHEL)	48	2	1	70.00	70.00
Generator Rotor (BHEL)	48	6	4	40.00	160.00
Generator Stator/Bar	4	0	168	1.50	252.00
Generator Rotor (Non-BHEL)	4	2	2	40.00	80.00
Generator Exciter	48	6	4	20.00	80.00
Generator Spare bar	4608		460	1.50	690.00
PA Fan Motor	104	25	20	1.00	20.00
ID Fan Motor	104	25	20	4.05	81.00
FD Fan Motor	104	25	20	0.75	15.00
Mill Motor	452	52	52	1.50	78.00
BCW Motor	144	25	20	4.50	90.00
CW Motor	120	20	25	3.00	75.00
GT	156	26	26	15.00	390.00
MV Breaker	500	100	100	0.06	6.00
Total One time Expenditure (Spares)					2,081.00
Total additional Expenditure (Spares) per Unit					40.02



32

Electrical Opex for a 500 MW unit

Item Description	Population	Present Qty	Additional Requirement	Rate	Total Cost Implication(in Cr)
Overhauling of Generator	52	13	13	2.20	28.60
Overhauling of Motor	1028	257	257	0.07	17.99
Repair of HT Motor	1028	10	50	0.20	10.00
Repair of Generator Rotor	52	2	5	4.00	20.00
Repair of Stator (Leakage)	52	3	10	1.00	10.00
Repair of Transformer	144	1	10	5.00	50.00
Total Expenditure (Services)					136.59
Total additional Expenditure (Services) per Unit					2.63



C&I Capex & Opex for a 500 MW Unit

Capex

S No	C&I	Approx Cost (Rs Crores/unit)
1	Control strategy implementation for low load operation (Extending CMC up to 40% / ramp rate improvement / improved controls for Steam temp, Drum level, Feedwater pumps, etc / Start & stop sequence for drives / Mill Scheduler / etc)	6.1
2	Individual control of SADC actuators	1.00
3	High speed and high accuracy blade pitch actuators	0.90
4	Flame Scanners with provision for intensity and frequency outputs	2.00
	Total	10.0

Opex

S No	C&I	Approx Cost (Rs crores/unit)
1	Consumables & repair cost during annual overhauls	0.10
2	Breakdown maint.	0.02
	Total	0.120



Other Capex & Opex for a 500 MW unit

Capex

S No	Others heads	Approx Cost (Rs Crores/unit)
1	System to facilitate operator in detecting equipment damages at incipient stage while operating the machine in new Regime, like Advanced Pattern Recognition, etc Based on last PO of 38 crores and scalation for 22 units. Total cost 48 cr.	2.1


Opex

S No	Others	Approx Cost (Rs Crore /unit)
1	Capacity building - training / refresher training to operators at regular intervals / Workshops on operational issues faced in the new Regime	0.12



Engie Labs Recommendations

Sno	Attribute	Unit	For similar multiple units	For single units or different multiple units
1	Control loop adjustments			
i)	Control loop tuning water/steam cycle	Rs-Lacs/Unit	127.5	170
ii)	Improvement of a coordinated master control	Rs-Lacs/plant technology	255	425
iii)	Development of a start-up/shutdown master sequence	Rs-Lacs/plant technology	255	425
iv)	Single point of vulnerability study	Rs-Lacs/plant technology	85	170
v)	Start-up good practices development	Rs-Lacs/plant technology	127.5	425
2	Firing system: mills to burners			
i)	Combustion and Mills testing and tuning	Rs-Lacs/Unit	212.5	340
ii)	Upgrade of flame detection system	Rs-Lacs/Unit	170	425
iii)	Hydraulic model air ducts and windbox	Rs-Lacs/Unit	85	127.5
3	Condition Monitoring tool implementation & follow-up			
i)	Vibration monitoring	Rs-Lacs/Unit	42.5	85
ii)	Rotor stress Calculator	Rs-Lacs/Unit	63.75	255
iii)	Early fault detection software	Rs-Lacs/Unit	127.5	255
iv)	Partial Discharge monitoring	Rs-Lacs/Unit	25.5	42.5
v)	Rotor Flux monitoring	Rs-Lacs/Unit	12.75	42.5
vi)	Condition monitoring tools yearly follow up	Rs-Lacs/Unit per year	21.25	42.5
vii)	Performance monitoring tool development & follow up	Rs-Lacs/Unit per year	21.25	42.5
4	Boiler repairs and upgrades			
i)	De-superheating concept modification and/or upgrade	Rs-Lacs/Unit	255	510
ii)	Additional Update drain lines for effective draining	Rs-Lacs/Unit	340	1275
iii)	Reheater and Final superheater tube replacement	Rs-Lacs/Unit	680	1275
iv)	Chemical cleaning of Final Superheater and Reheater	Rs-Lacs/Unit	85	340
5	Generator repairs			
i)	Rotor rewinding	Rs-Lacs/Unit	595	850
ii)	Significant repairs on rotor, but no rewind/replace rotor pole connections	Rs-Lacs/Unit	340	595
6	Specific studies			
i)	Finite Element Modelling and Evaluation of Pressure and Temperature	Rs-Lacs/type of equipment	42.5	340
ii)	Remaining Life Assessment / Fitness for service	Rs-Lacs/component	63.75	170
iii)	Boiler Life Management	Rs-Lacs/Unit	42.5	85
iv)	Headers remaining lifetime assessment (3 critical collectors)	Rs-Lacs/Unit	127.5	212.5
7	Steam Turbine			
i)	Placement of erosion protection rings f2 flux) for the LP casing	Rs-Lacs/ LP ST	425	850
ii)	Maintenance on LP rotating blades and replacement of LO (2 fluxes)	Rs-Lacs/ LP ST	850	1275
iii)	Valve internals (Control Valves)	Rs-Lacs/ LP ST	340	425
iv)	Electrical heating on the steam turbine and admission valves	Rs-Lacs/ LP ST	170	340
Total		Lacs	5988.25	11815
		Cr	60	118





Initiatives at Dadri & Simhadri

NTPC Experience: Intervention Areas



On an average NTPC Units Flex 15 GW on daily basis. Non Pit Head Stations Flex from 55% to 100%. This has resulted in challenges in Boiler, Turbine, Control Systems which NTPC is addressing on continuous basis.

Area	Challenges	Mitigation Measures
Boiler	<ul style="list-style-type: none"> • Temperature Variations leading to High BTL • Poor Combustion (Reliability Issue, Higher Risk, Efficiency Issues) • Coal Pipe Chocking & Duct Ash Accumulation • High FEGT • Economiser Steaming 	<ul style="list-style-type: none"> • Tuning Group at CC & Site • Design Modifications • Adoption of latest tests, techniques and procedures.
Turbine	<ul style="list-style-type: none"> • LPT last stage blade erosion & flutter. • Wear and tear on valves due to severe throttling • Turbine Rotor, Casing, and Valve body cracking • Low load deposition on turbine due to steam purity issue • Less Motive power for TDBFP from main source and control issues 	<ul style="list-style-type: none"> • RLA- 6 Yrs. Replacement of casings & rotor in 15 yrs • Frequent inspection (2 yrs), MPI- In-situ PAUT • Turbine Bearings inspection in every 2 yrs • More frequent replacement of casings, rotors • Maintain Water Chemistry
Operations	<ul style="list-style-type: none"> • High Ash deposition on ducts. • Soot blowing difficulty, Need > 70% load for 3 hr in a day • Flame disturbance tripping on Coal Quality variations • Higher chances of outage due to single Aux Eqp approach. • Chemistry parameter variation (PH, Conductivity, DO etc) 	<ul style="list-style-type: none"> • Unlearn and Relearn Strategy • New Operational Practices
Controls	<ul style="list-style-type: none"> • AGC • RGMO 	<ul style="list-style-type: none"> • Loop Tuning • Interventions through Policy advocacy for changes in procedures

