

Get Ready for Flexibilisation

Indo-German Energy Partnership

October 2023



vgbe energy e.V. – Who We Are

- 411 members in 29 countries
- Members represent an installed renewable and conventional capacity of 292 GW



vgbe is the International Technical Association of energy plant operators. Founded in 1920, the association covers a wide range of technologies: from renewable and conventional power and heat generation to energy storage and P2X.

1 Indo-German Energy Partnership



Background and Working Programm



A special Task Force on Flexibilisation was constituted in May, 2016 under the Sub-Group of the Indo-German Energy Forum, under the Chairmanship of Director (Operations), NTPC and with following members:

- India: Excellence Enhancement Centre (EEC) – Task Force Secretariat, POSOCO, CEA, BHEL and NTPC
- Germany: IGEF/GIZ, VGB and KWS (Power Plant Training Centre)

Technical Studies

- Reference plant assessments at Dadri und Simhadri, 2017
- *Flexibility Toolbox*, 2018
- Test Runs in different power plants 2018–2022
- Implementation of measures at Dadri, finished in 2022
- Verification of results → ***Flexibility Field Report***, published in January 2023
- Short ***Study on Thermal Electricity Storage in India***, published in January 2023

Capacity Building

- > 200 Indian delegates visited Germany for training, study tours and experience exchange
- > 20 National conferences, seminars and workshops
- Development of a flexibility simulator and training programme for power plant personnel
- **1-week simulator training** with STEAG India – first batch was successfully concluded on 7 Oct
- Set-up of a flexibility simulator at STEAG India
- Study tour to Germany planned for November 2023 and March 2024

Flexibility Test Runs at 500 MW Units



Dadri 2018
40% Load, 3% Ramp rate



DVC Andal 2022
30% load, 2% ramp rate










36% Load, 1.5% Ramp rate

How to flexibilize the plant

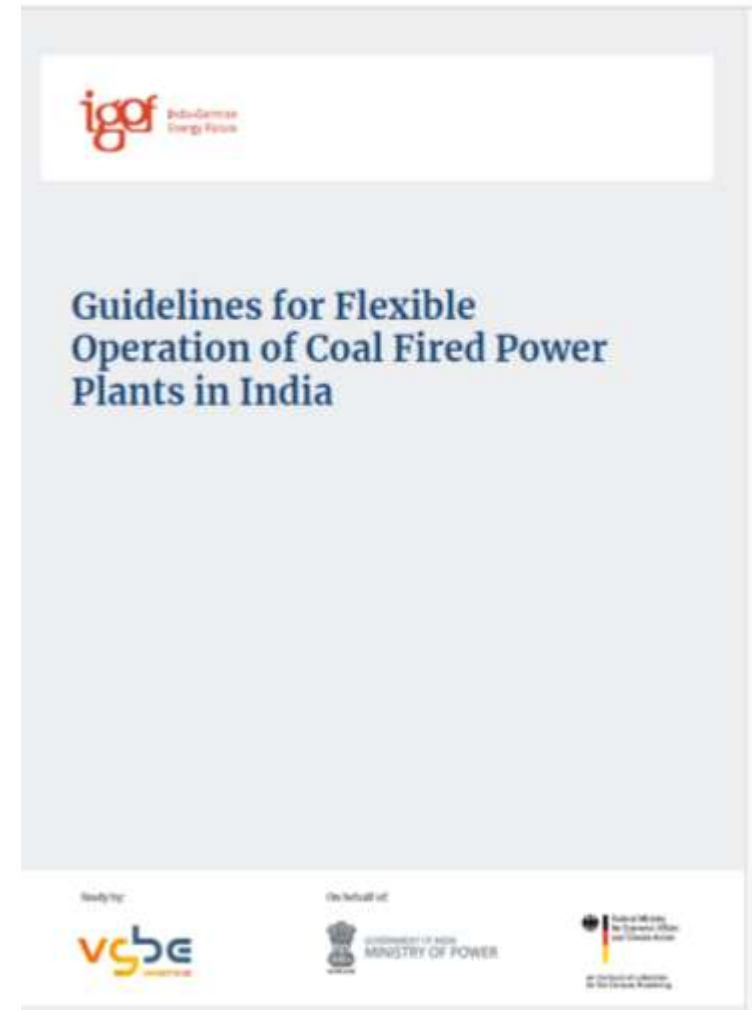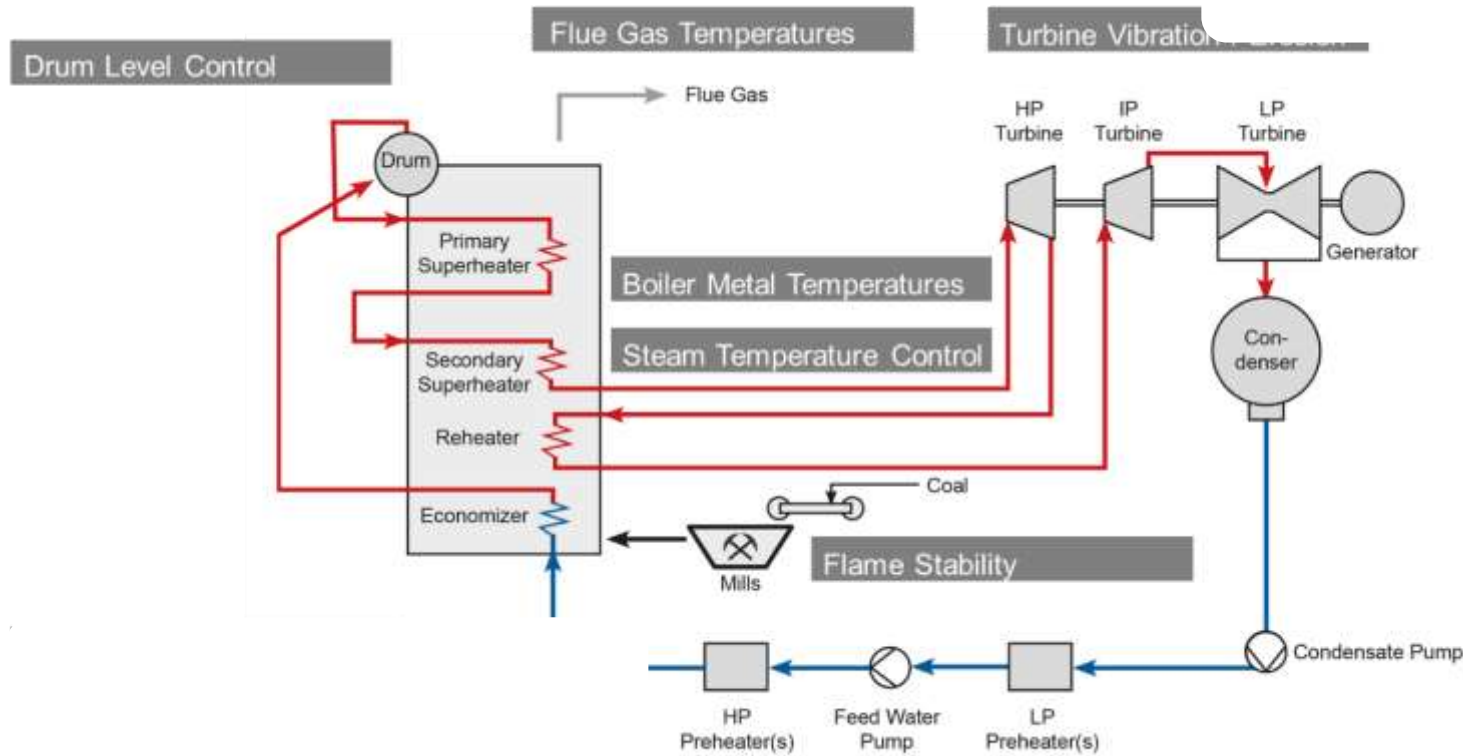

Main Fields of Action



-  Conduct own test runs to in order to enhance your knowledge about the plant behaviour in part load
-  Collect your own best practices – e.g. for start-up, shut-down, mill scheduling and frequency control – and identify new procedures for your plant
-  An automatized start-up and shut-down sequence of main equipment is beneficial for flexible operation → check, if your DCS system has such sequences which were never commissioned
-  Develop a concept for condition monitoring in order to mitigate the consequences of flexible operation
-  Simulator training is very useful to obtain practical skills in flexible operation as well as to try out different operational concepts

How to become a



Study

e-learning, awareness workshops and professional seminars

Target: acknowledge the need for flexibility, understand principles of flexible power plant operation

4 weeks

Try

a) Simulator training to try out flexible operation at an Indian reference plant

b) Test runs at own plant (according to IGEF procedure) guided by own senior or external experts


4 weeks

Apply

Implement new procedures in the operational scheme (e.g. mill sequences, switch over of pumps and fans)

- Increase level of automation for routine sequences and optimize subordinate controls
- Optimize main control loops and implement advanced control solutions

Continuous improvement process

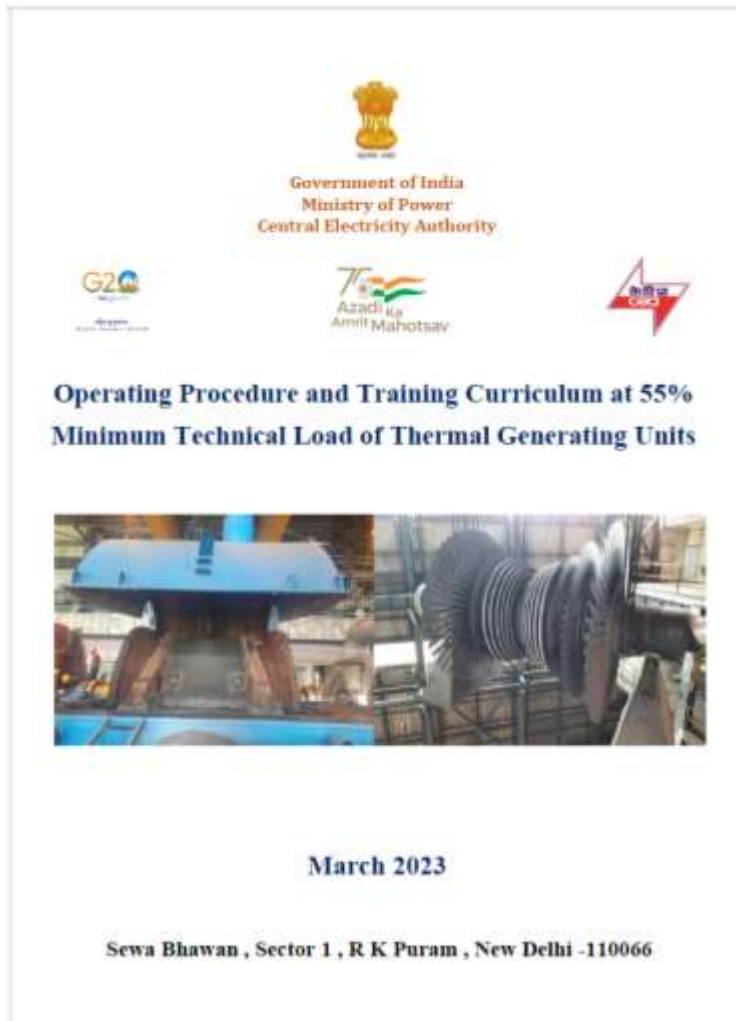

- Standard Operating Procedures for safe operation at 55% load
- Training Curriculum
- Collates and synthesizes learnings from various flexibility initiatives



- Outline for the Flexibilization of Indian Power Plants
- Provides guidance and recommendation for the practical implementation

Simulator for Flexperts



Simulator

- Simulator model of an 500 MW coal-fired unit for flexibility trainings for operating personnel
- Development of a full-fledged training programme for flexible power plant operation
- Implementing partners are Steag India and ProTrax (USA) with support from GIZ and vgbe
- Nucleus for pan-Indian training initiatives


Important Milestone:
One-week simulator training conducted by STEAG at Mahagenco's Konradi Training Center



2 Indo-German Energy Partnership



Electricity Mix in 2022

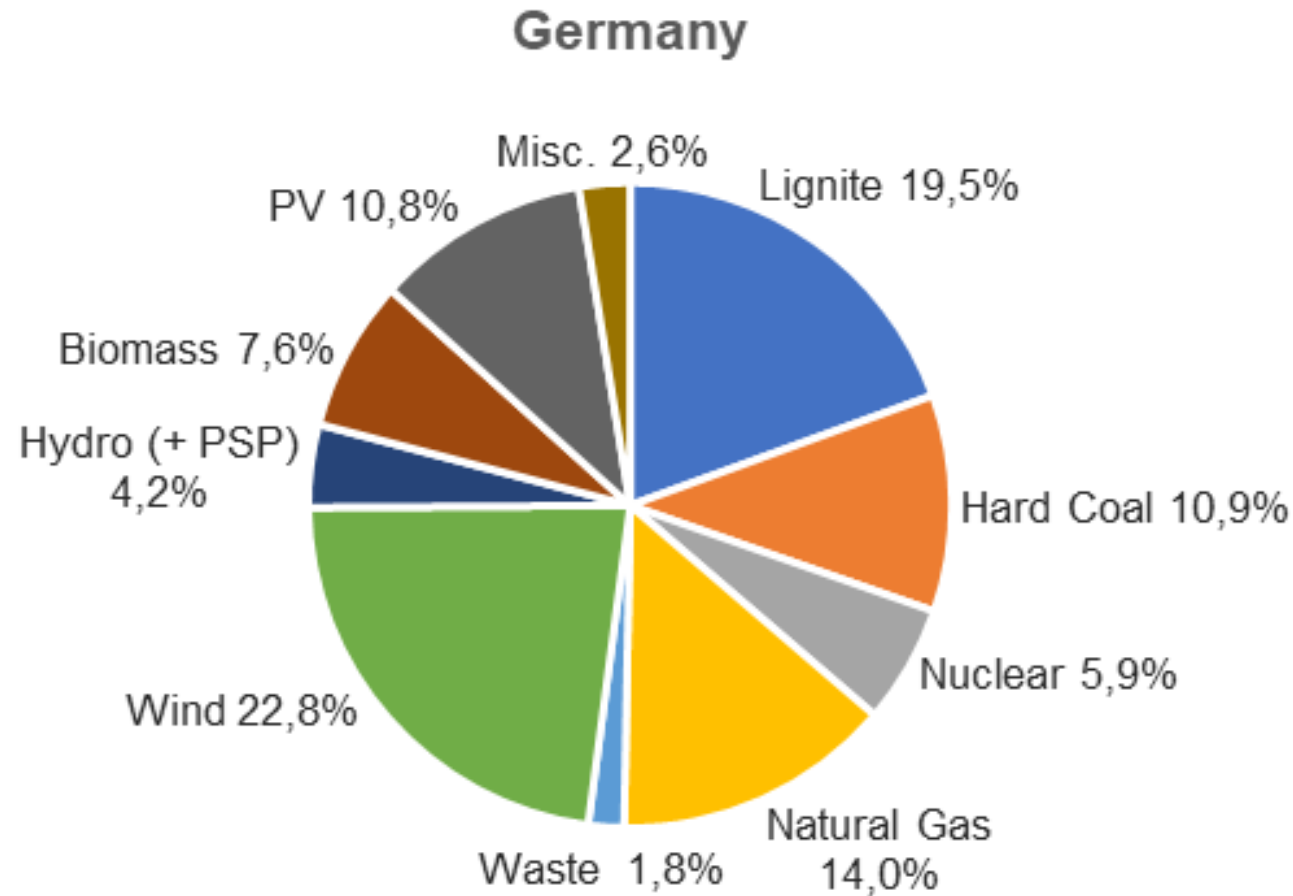

Net electricity production: **551 TWh**

Installed Capacity:

Lignite: **17.7 GW**

Hard Coal: **18.1 GW**

Natural Gas: **31.8 GW**

Wind: **65.7 GW**


PV: **63.0 GW**

Coal Phase-out in 2038 (2030)

- Lignite
- Hard Coal
- Nuclear
- Natural Gas
- Waste
- Wind
- Hydro (+ PSP)
- Biomass
- PV
- Misc.

Source: AG Energielizenzen, <https://ag-energiebilanzen.de/>

Development of Power Plant Technology Drivers

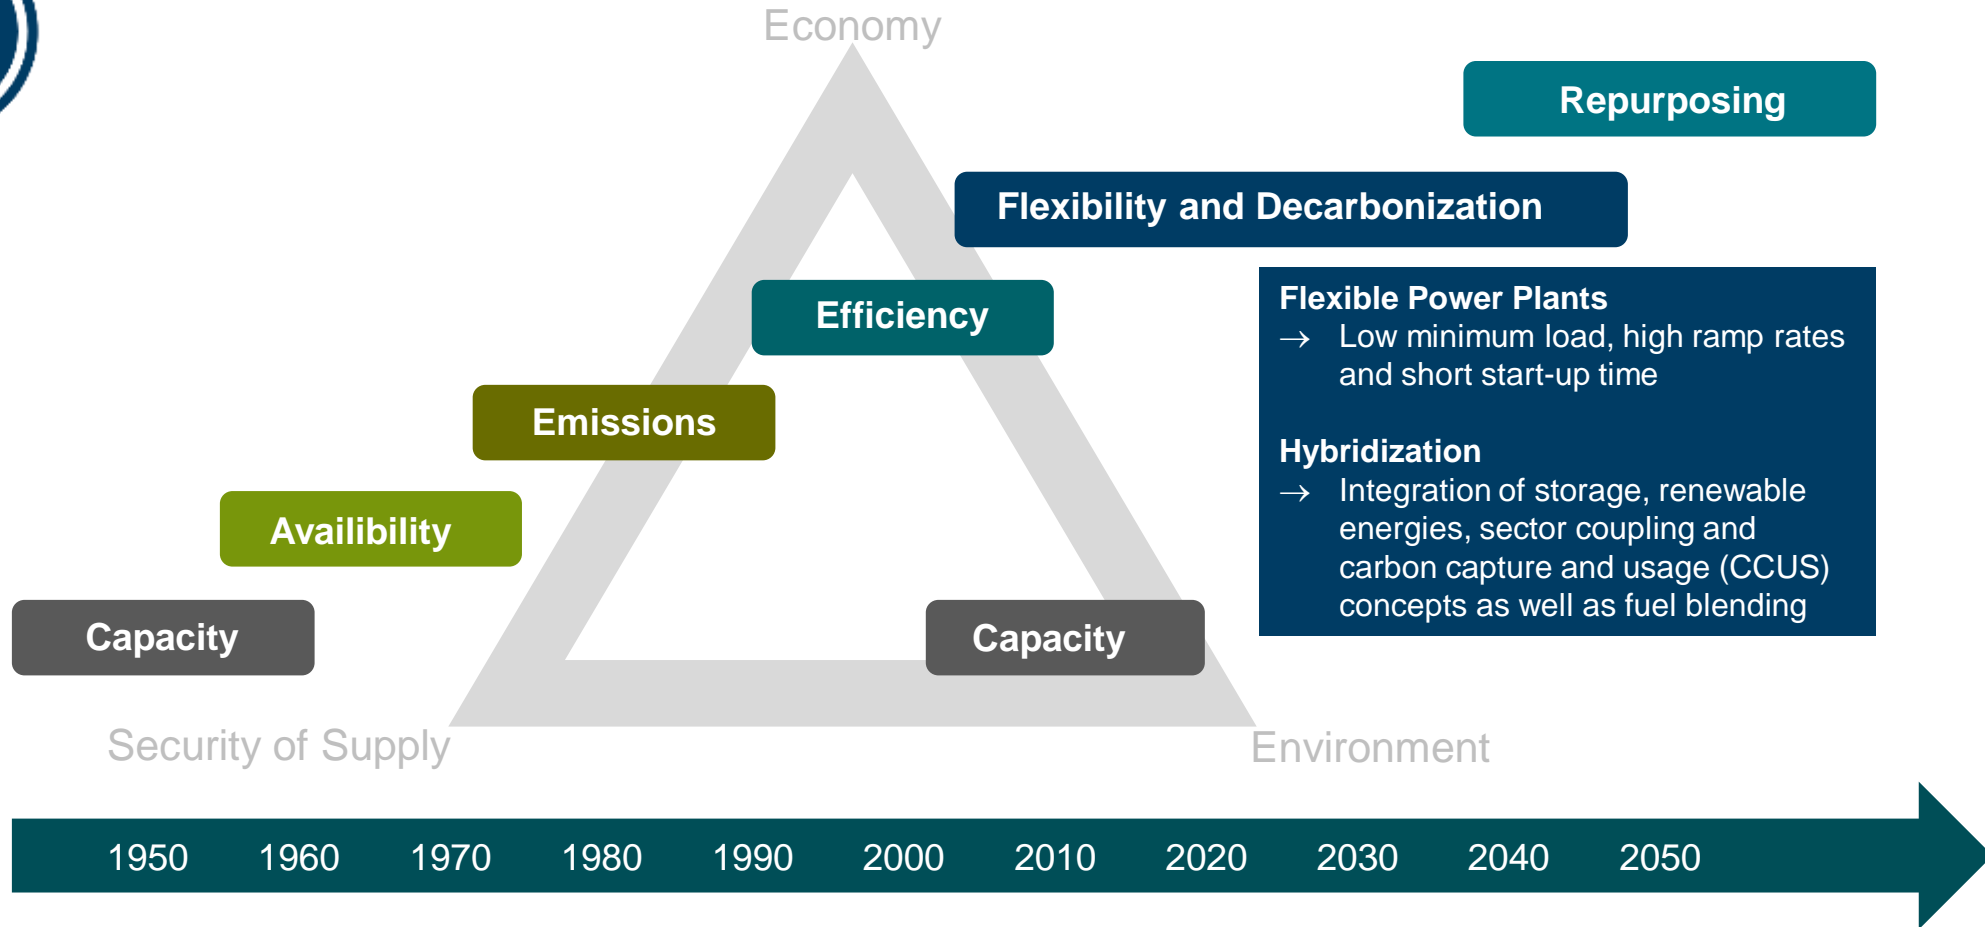

Benefits by Repurposing Coal Plant Sites

Well developed infrastructure

External – access to:



Grid



Transport: harbour, roads and railway



Gas network



Water



District heating

Miscellanea



Highly qualified personnel



Availability of space



Existing permits



Saving decommissioning cost

Well developed infrastructure

Internal



Digitalized site



Cooling systems



Water treatment



Heating systems



Steam systems

Consumption near-by



Households and offices



Business and agriculture



Industry

Options for Hybridization of Power Plants

Renewable Energies



Capacity extension with PV and/or wind energy plants

Sector Coupling



From heat and steam provision to the integration of H₂ production and CCUS as well as the production of green gases and/or biofuels

Storage



Integration of storage systems such as large scale batteries as well as thermal and mechanical storage

Source of picture: Steag GmbH

Fuel Blending



Partial fuel substitution with biomass or green gases

Repurposing of Power Plants: Example 1



Need for dispatchable capacity – fuel switch activities



Stuttgart-Münster

- Gas turbine plant with 124 MW_{el} and waste heat steam generator
Decommissioning of coal-fired boilers and gas turbines



Heilbronn

- H₂-ready CCGT plant with 675 MW_{el} and up to 190 MW heat output
Decommissioning of HLB7 coal unit with 778 MW_{el}




Altbach/Deizisau

- H₂-ready CCGT plant with 665 MW_{el} and up to 180 MW heat output
Decommissioning of HKW2 coal unit with 401 MW_{el}

The double fuel switch (from coal to gas and then to H₂) helps build a balanced portfolio of renewables and dispatchable capacity and is in line with EnBW's 2035 climate neutrality target

Innovative storage power plant Jänschwalde – main components

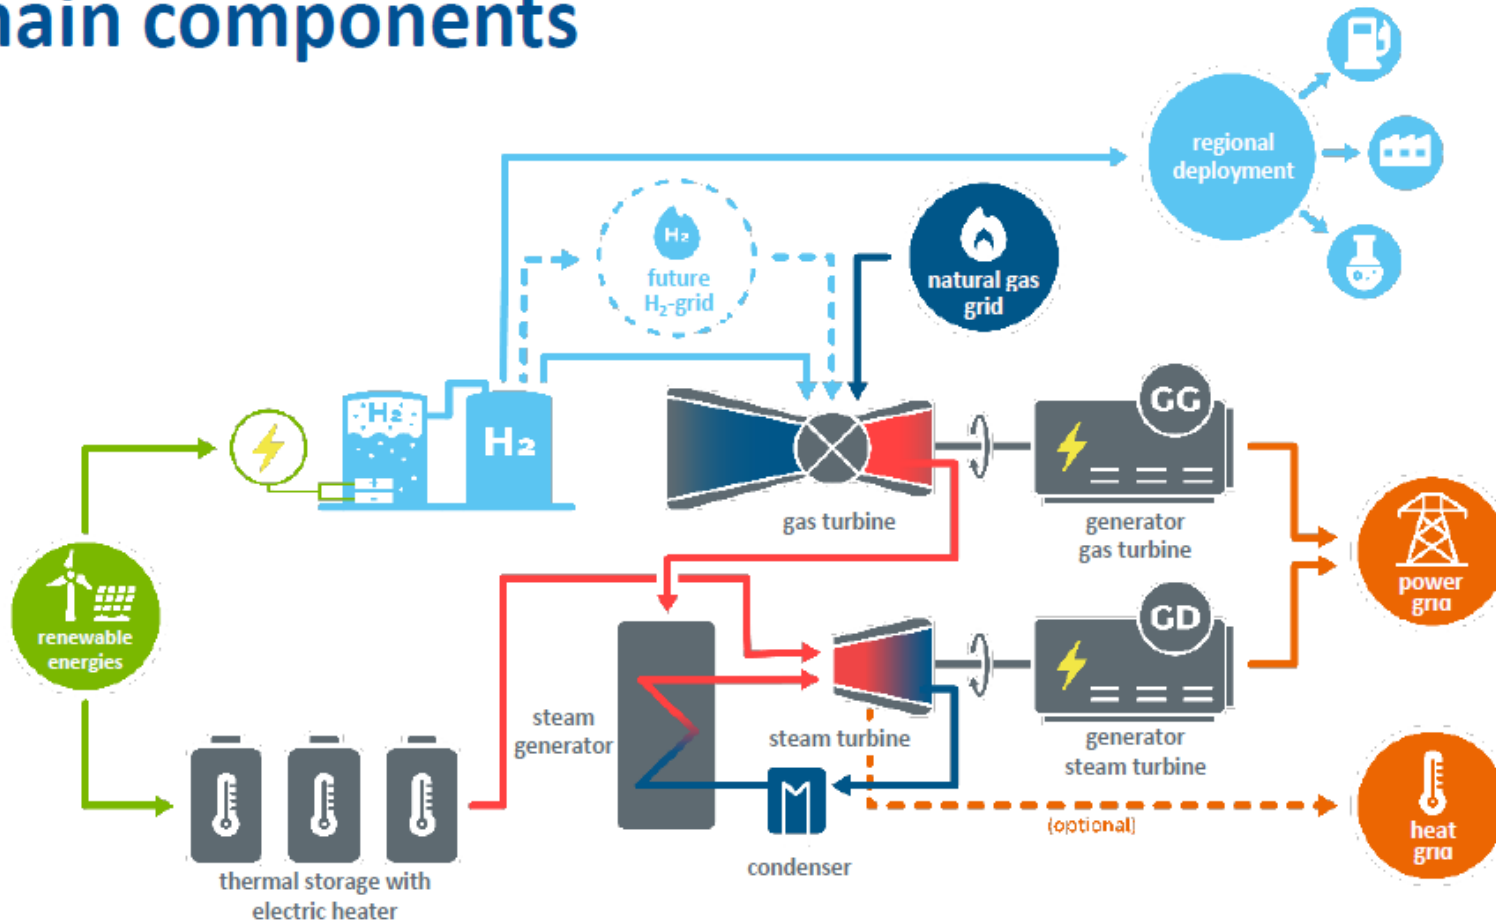

- high-efficient **H₂-ready CCGT plant**
- **thermal energy storage** with electric heater for storing renewable electricity
- production, storage and energetic utilisation of **green hydrogen**
- green hydrogen supply for **industry and mobility**

Thank you for your attention.

be energized

be inspired

be connected

be informed

Contact

Dr.-Ing. Claudia Weise
Project Director
of International Affairs

vgbe energy e.V.

Deilbachtal 173, 45257 Essen
Germany

M +49 151 2524 8343

E claudia.weise@vgbe.energy

I www.vgbe.energy